



- [26] PLEASE PROVIDE GUTTER IN BOTH ROOM AND SUMP IN POWER SUPPLY UNIT ROOM AT SUITABLE LOCATION TO COLLECT DRAINED WATER.
- [27] KEEP THE PROVISION FOR WATER PIPE LINE ENTRY IN THE ROOM.
- [28] PLEASE NOTE "WARNING" GIVEN BELOW.

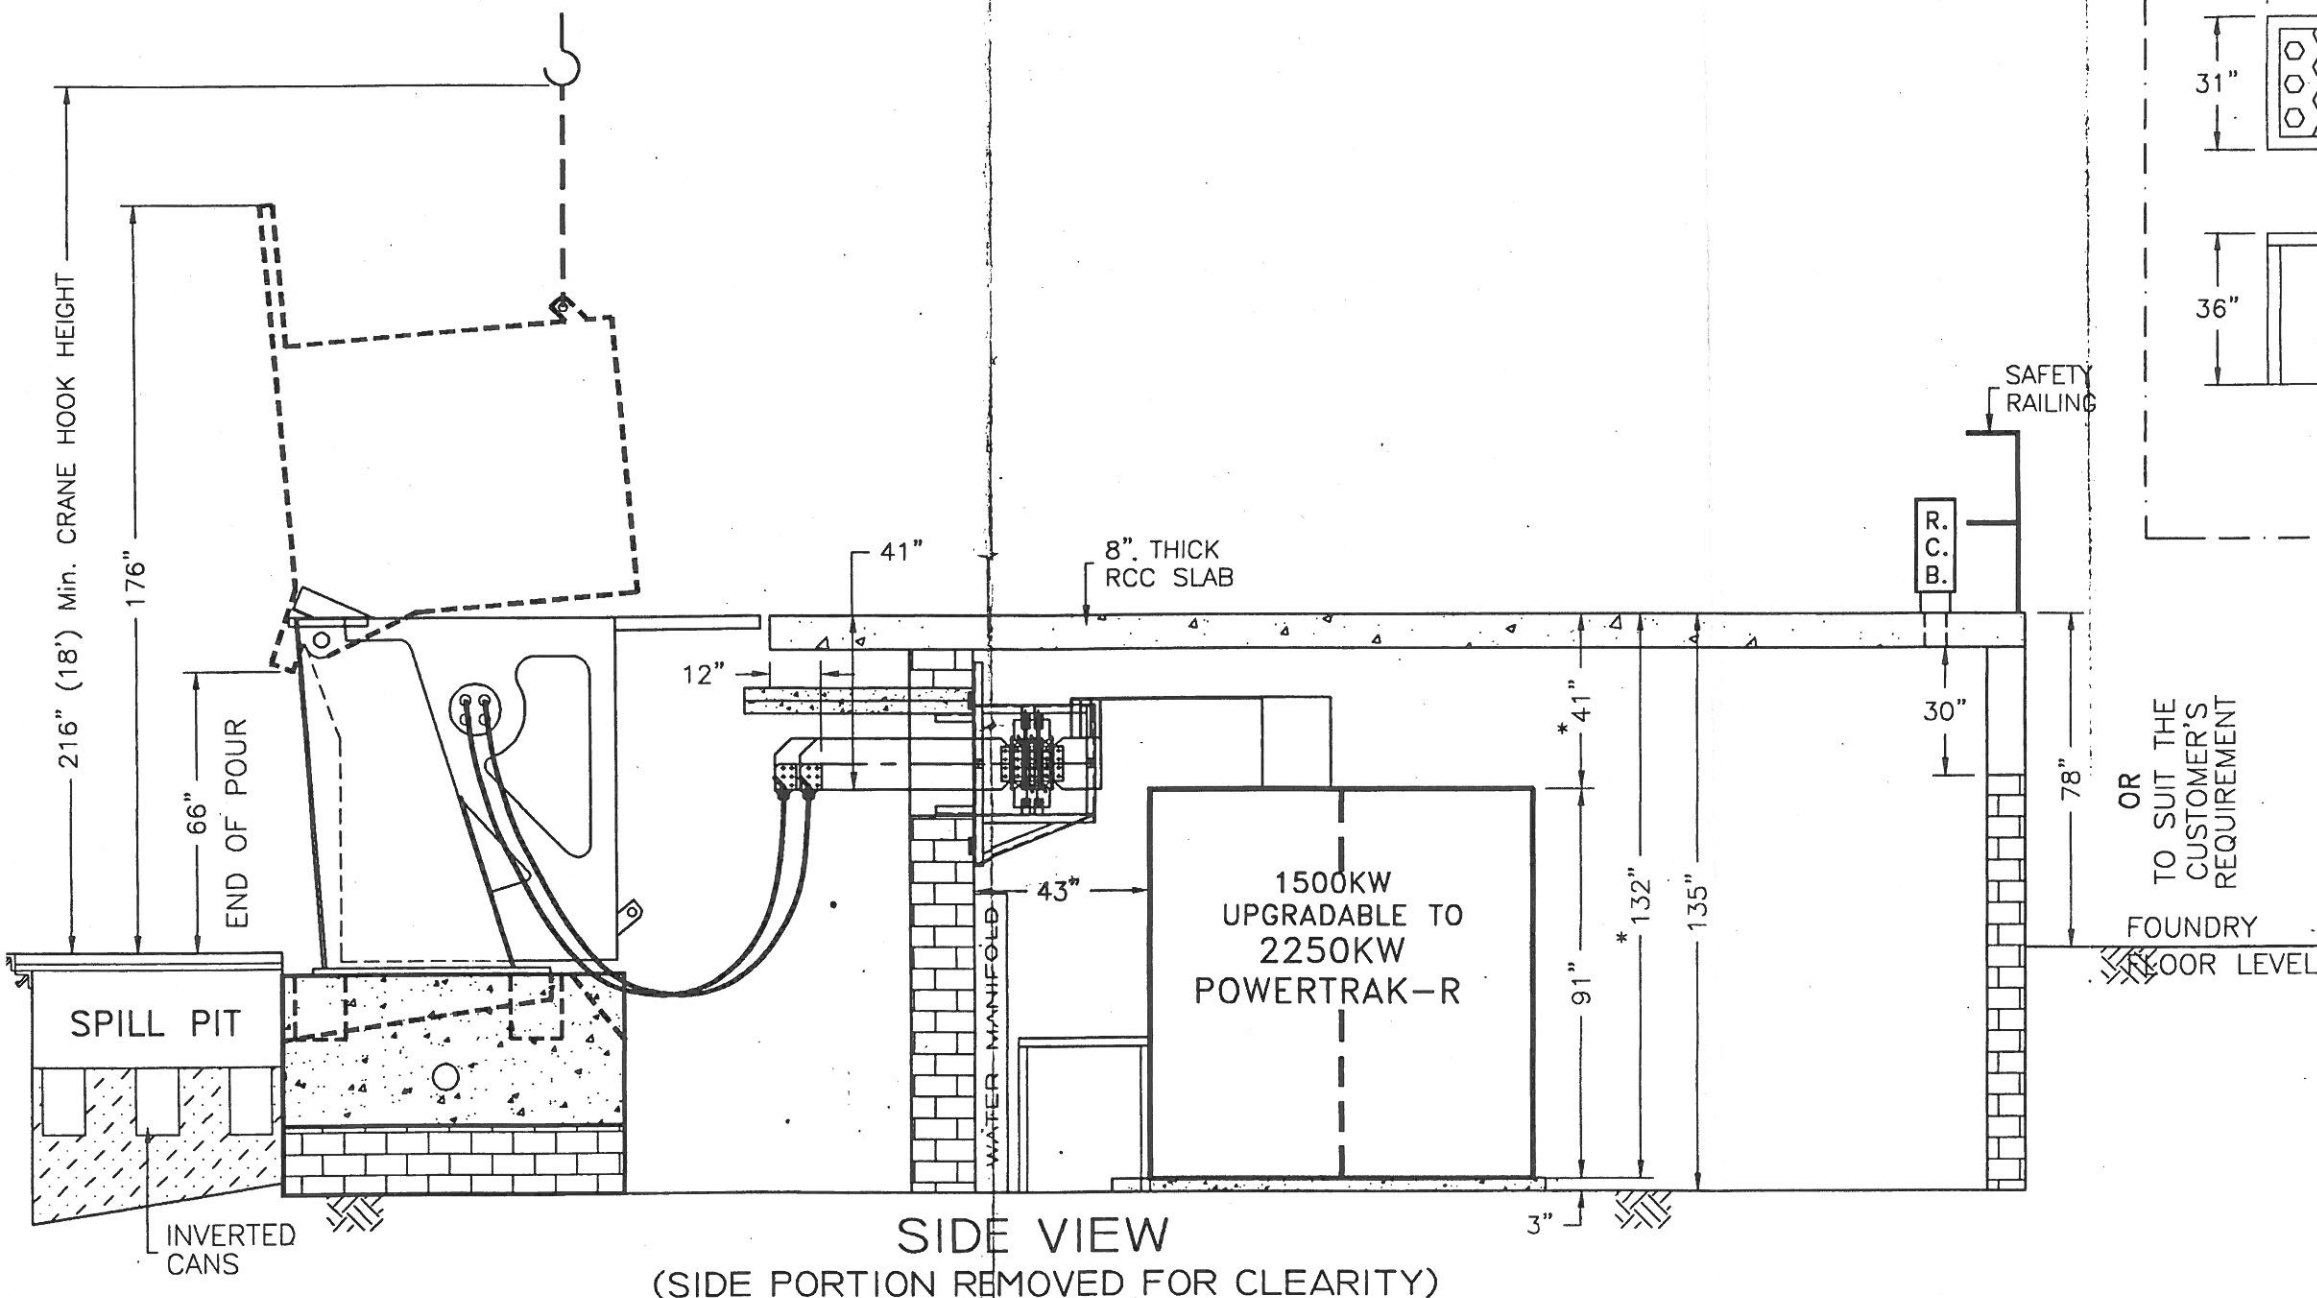

Code	Zone	Brief Record	Date	Drn.	Chd.	Appd.

Revision Details

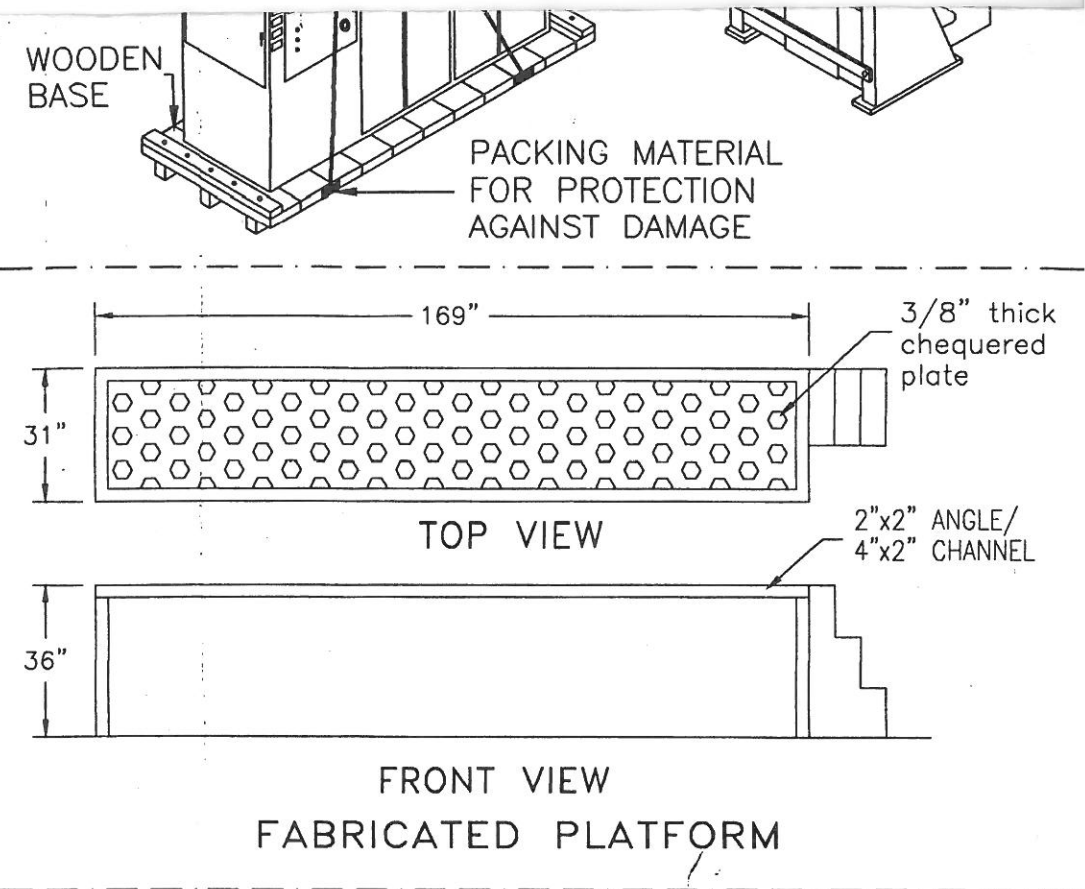

INDUCTOTHERM (INDIA) LTD., AHMEDABAD

Customer:

Title: LAYOUT DETAILS FOR 1500KW UPGRADABLE TO 2250KW POWERTRAK-R WITH 3000Kg.x2Nos., DURALINE (F) FURNACES

Drn. by	23.07.02	Drawing No.	Rev.
Chd. by	23.07.02	D-93665	A
Appd. by	23.07.02		
Scale	1 : 45	Used on/Drg. No. D-93449/1	Sheet No. 1 OF 2

WARNING :

SUITABLE ARRANGEMENTS MUST BE MADE TO DRAIN THE SPILL PIT AREA AND MAINTAIN IT IN A DRY CONDITION. MOISTURE OR WATER ACCUMULATION IN THE RUNOUT APRON OR SPILL PIT AREA CAN CAUSE A VIOLENT EXPLOSION IF MOLTEN METAL ENTERS THESE AREAS. SERIOUS INJURY TO PERSONNEL AND SEVERE DAMAGE TO EQUIPMENT CAN RESULT FROM FAILURE TO OBSERVE THESE PRECAUTIONS.

Issued on 13/8/02
Dept Project
Sign

PROPRIETARY INFORMATION
PROPERTY OF
INDUCTOTHERM CORP. U.S.A.

THIS DRAWING CONTAINS PROPRIETARY AND CONFIDENTIAL INFORMATION BELONGING TO INDUCTOTHERM CORP. THIS DRAWING MAY NOT BE REPRODUCED OR COPIED IN WHOLE OR IN PART NOR CAN THE INFORMATION CONTAINED BE USED FOR ANY PURPOSE WITHOUT THE EXPRESS WRITTEN PERMISSION OF INDUCTOTHERM CORP. THIS DRAWING IS THE PROPERTY OF INDUCTOTHERM CORP. AND MUST BE RETURNED UPON REQUEST

THIS DRAWING IS LOANED BY INDUCTOTHERM CORP. TO THE CUSTOMER OR USER AS A GENERAL DESCRIPTION OF THE EQUIPMENT AND IS TO BE USED FOR THE PROPER INSTALLATION AND OPERATION OF THIS EQUIPMENT. THIS DRAWING MAY NOT BE COPIED IN WHOLE OR IN PART NOR CAN IT BE USED FOR THE MANUFACTURE OF ANY EQUIPMENT WITHOUT THE EXPRESS WRITTEN PERMISSION OF INDUCTOTHERM CORP.